

# 产品认证证书

## II型自愿认证

证书编号: CQC21012284353

发证日期: 2021年07月28日

有效期至: 2026年02月24日

委托人名称 及注册地址	德力西集团有限公司 浙江省乐清市柳市镇柳青路1号(德力西大厦 另设分支机构经营场所 乐清市柳市镇站东路155号)
制造商名称 及注册地址	德力西集团有限公司 浙江省乐清市柳市镇柳青路1号(德力西大厦 另设分支机构经营场所 乐清市柳市镇站东路155号)
生产企业名称 及生产地址	德力西集团有限公司 乐清市柳市镇站东路155号
产品名称和系列、 规格、型号	隔离开关 CDH8-630, CDH8-400;具体参数和型号解释详见附件
产品标准和技术要求	GB/T 14048.3-2017
认证模式	产品型式试验+初次工厂检查+获证后监督

上述产品符合 CQC12-000001-2020 认证规则的要求, 特发此证。

本证书为变更证书, 证书首次颁发日期: 2021年02月24日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

可通过扫描下方二维码或登录国家认监委网站(www.cnca.gov.cn)查验证书信息



授权签字人

签发

陈昕

谢肇煦



中国质量认证中心

# 产品认证证书

## II型自愿认证

证书编号: CQC21012284353

第 1 页 共 3 页

本证书及附件应同时使用, 信息查验说明见证书页

纸号:

CDH8-630, CDH8-400

Uimp: 12kV;

Ui: 1000V;

Ith: 400A(CDH8-400), 630A(CDH8-630);

Ue: AC400V, AC690V, DC250V, DC500V;

Ie: 315A, 400A, 500A, 630A(AC400V, DC250V);

315A, 500A(AC690V, DC500V);

Icw: 20kA/1s(CDH8-630), 15kA/1s(CDH8-400);

Icm(峰值): 42kA(CDH8-630), 28kA(CDH8-400);

AC-23B, DC-23B, DC-PV1;

2P, 3P, 4P;



中国质量认证中心

# 产品认证证书

## II型自愿认证

证书编号: CQC21012284353


第 2 页 共 3 页

本证书及附件应同时使用, 信息查验说明见证书页

纸号:

直流产品接线方式:

CDH8直流接线图

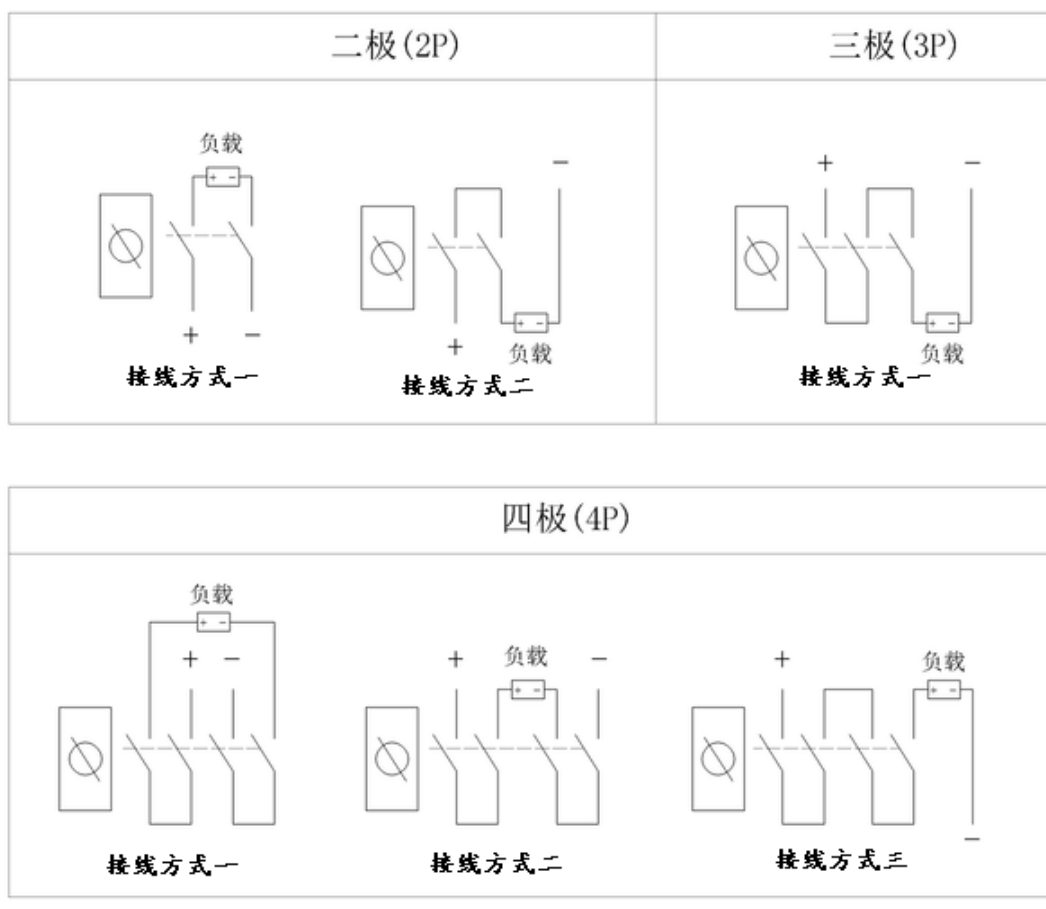

中国质量认证中心

# 产品认证证书

## II型自愿认证

证书编号：CQC21012284353

第 3 页 共 3 页

本证书及附件应同时使用，信息查验说明见证书页

纸号：

CD H 8 - □ / □□ □  
I II III IV V VI

I：企业代号

II：隔离开关

III：设计代号

IV：约定发热电流:A

V：极数，第一位表示机构左侧的极数、第二位表示机构右侧的极数；

02:2 极（二极均在机构右侧）

03:3 极（三极均在机构右侧）

04:4 极（四极均在机构右侧）

20:2 极（二极均在机构左侧）

30:3 极（二极均在机构左侧）

40:4 极（二极均在机构左侧）

11:2 极（机构左侧一极，机构右侧一极）

12:3 极（机构左侧一极，机构右侧二极）

13:4 极（机构左侧一极，机构右侧三极）

21:3 极（机构左侧二极，机构右侧一极）

22:4 极（机构左侧二极，机构右侧二极）

31:4 极（机构左侧三极，机构右侧一极）

VI：“J”柜外操作，柜内操作不注



中国质量认证中心



# CERTIFICATE OF PRODUCT CERTIFICATION

## TYPE II CQC CERTIFICATION

CERTIFICATE NO.: CQC21012284353

Valid from: Jul.28,2021

Valid until: Feb.24,2026

**NAME AND REGISTERED ADDRESS OF THE APPLICANT** DELIXI Group Co., Ltd.  
(Delixi Mansion) No.1 Liuqing Road, Liushi Town, Yueqing, Zhejiang Province, P.R.China

**NAME AND REGISTERED ADDRESS OF THE MANUFACTURER** DELIXI Group Co., Ltd.  
(Delixi Mansion) No.1 Liuqing Road, Liushi Town, Yueqing, Zhejiang Province, P.R.China

**NAME AND LOCATION OF THE FACTORY** DELIXI Group Co., Ltd.  
NO.155 Zhandong Road, Liushi Town, Yueqing City

**PRODUCT NAME, MODEL AND SPECIFICATION** Switch-disconnector  
CDH8-630, CDH8-400;See the Appendix

**THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS** GB/T 14048.3-2017

**TYPE OF CERTIFICATION SCHEMES** Type Testing of Product + Initial Factory Inspection + Follow up Factory Inspection

This is to certify that the above mentioned product(s) complies with the requirements of certification rules of CQC12-000001-2020.

Date of original issued: Feb.24,2021

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

The certificate information is available through the QR code below or CNCA's website: [www.cnca.gov.cn](http://www.cnca.gov.cn)



SIGN BY

陈昕

SIGNATURE

谢肇煦



CHINA QUALITY CERTIFICATION CENTRE

# CERTIFICATE OF PRODUCT CERTIFICATION

## TYPE II CQC CERTIFICATION

CERTIFICATE NO. : CQC21012284353

page 1 of 1

paper:

This certificate and attachments shall be used at the same time, and the verification instructions can be found in the main certificate.

CDH8-630, CDH8-400;

Uimp: 12kV;

Ui: 1000V;

Ith: 400A(CDH8-400), 630A(CDH8-630);

Ue:AC400V, AC690V, DC250V, DC500V;

Ie: 315A, 400A, 500A, 630A(AC400V, DC250V);

315A, 500A(AC690V, DC500V);

Icw: 20kA/1s(CDH8-630), 15kA/1s(CDH8-400);

Icm(peak value): 42kA(CDH8-630), 28kA(CDH8-400);

AC-23B, DC-23B, DC-PV1;

2P, 3P, 4P;



**CHINA QUALITY CERTIFICATION CENTRE**